




POULSBO FIRE DEPARTMENT
POULSBO, WA
S.O. 145234 / 0109838
PUMPER
TYPHOON 4X2 CHASSIS

1500 GPM HALE QMAX-XS PUMP 750 GALLON WATER TANK 30 GALLON INTEGRAL CLASS "A" FOAM			HOSE LOAD:		
			250' OF 2.50" DJ		
			200' OF 2.50" DJ		
			800' OF 2.50" DJ		
			1000' OF 5.00" LDH		
			200' OF 1.75" DJ		
COMPT.	OPENING		INTERIOR DIMENSION		
L1/R1	30W	68H	30W	34H	12D UPPER
			30W	30H	26D LOWER
L2/R2	56W	34H	56W	34H	12D
L3/R3	50W	68H	50W	34H	12D UPPER
			50W	30H	26D LOWER
B1	36W	21H	38W	30H	27D
THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.					
(FOR INTERNAL SALES PURPOSES ONLY)					
DEALER APPROVAL _____		DATE _____		☐ AS IS	
CUSTOMER APPROVAL _____		DATE _____		☐ WITH REVISIONS	

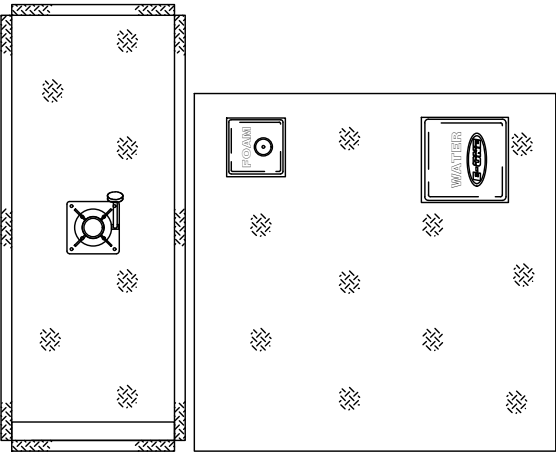

HOSEBED HEIGHT:
(FOR REFERENCE ONLY)
TO SLIDING PLATFORM: 49"
TO GROUND: 66±2"

NO LIP

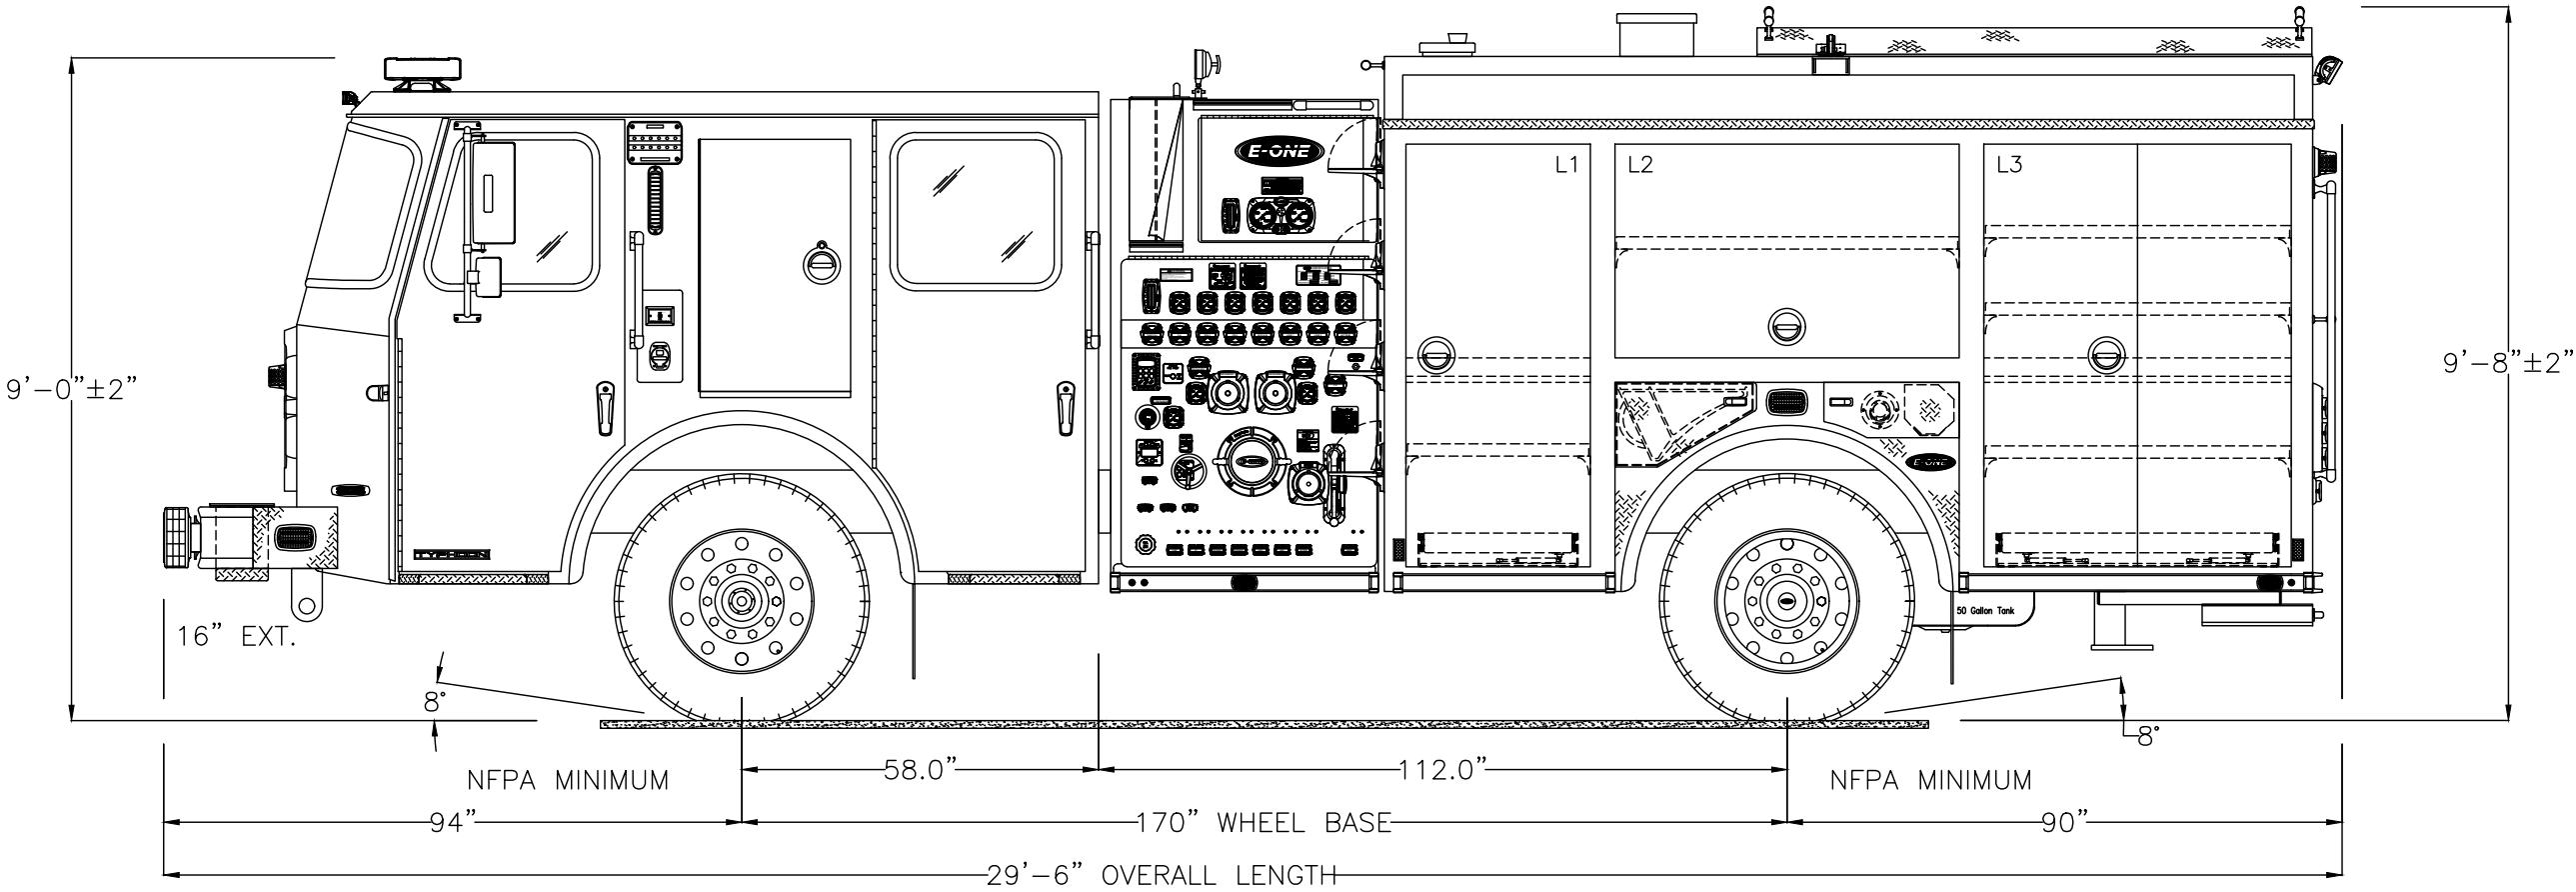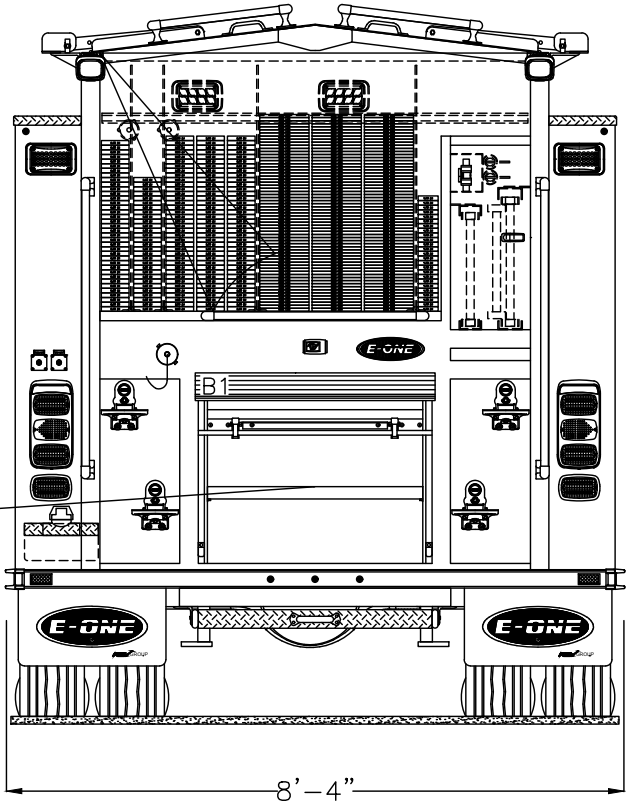

DRODMAN	A.6	ORDER RELEASE	2022-MAY-13	DRODMAN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
APPROVAL		REVISIONS		SHEET 1 OF 2



POULSBO FIRE DEPARTMENT
POULSBO, WA
S.O. 145234 / Q109838
PUMPER
TYPHOON 4X2 CHASSIS

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE
SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

(FOR INTERNAL SALES PURPOSES ONLY)

DEALER APPROVAL



DATE

☐AS IS

CUSTOMER APPROVAL

DATE

☐WITH REVISIONS

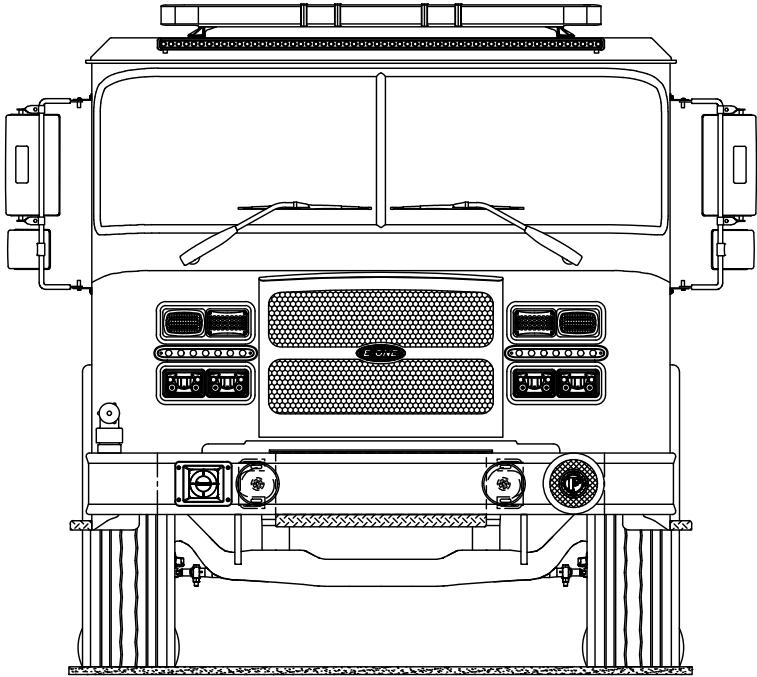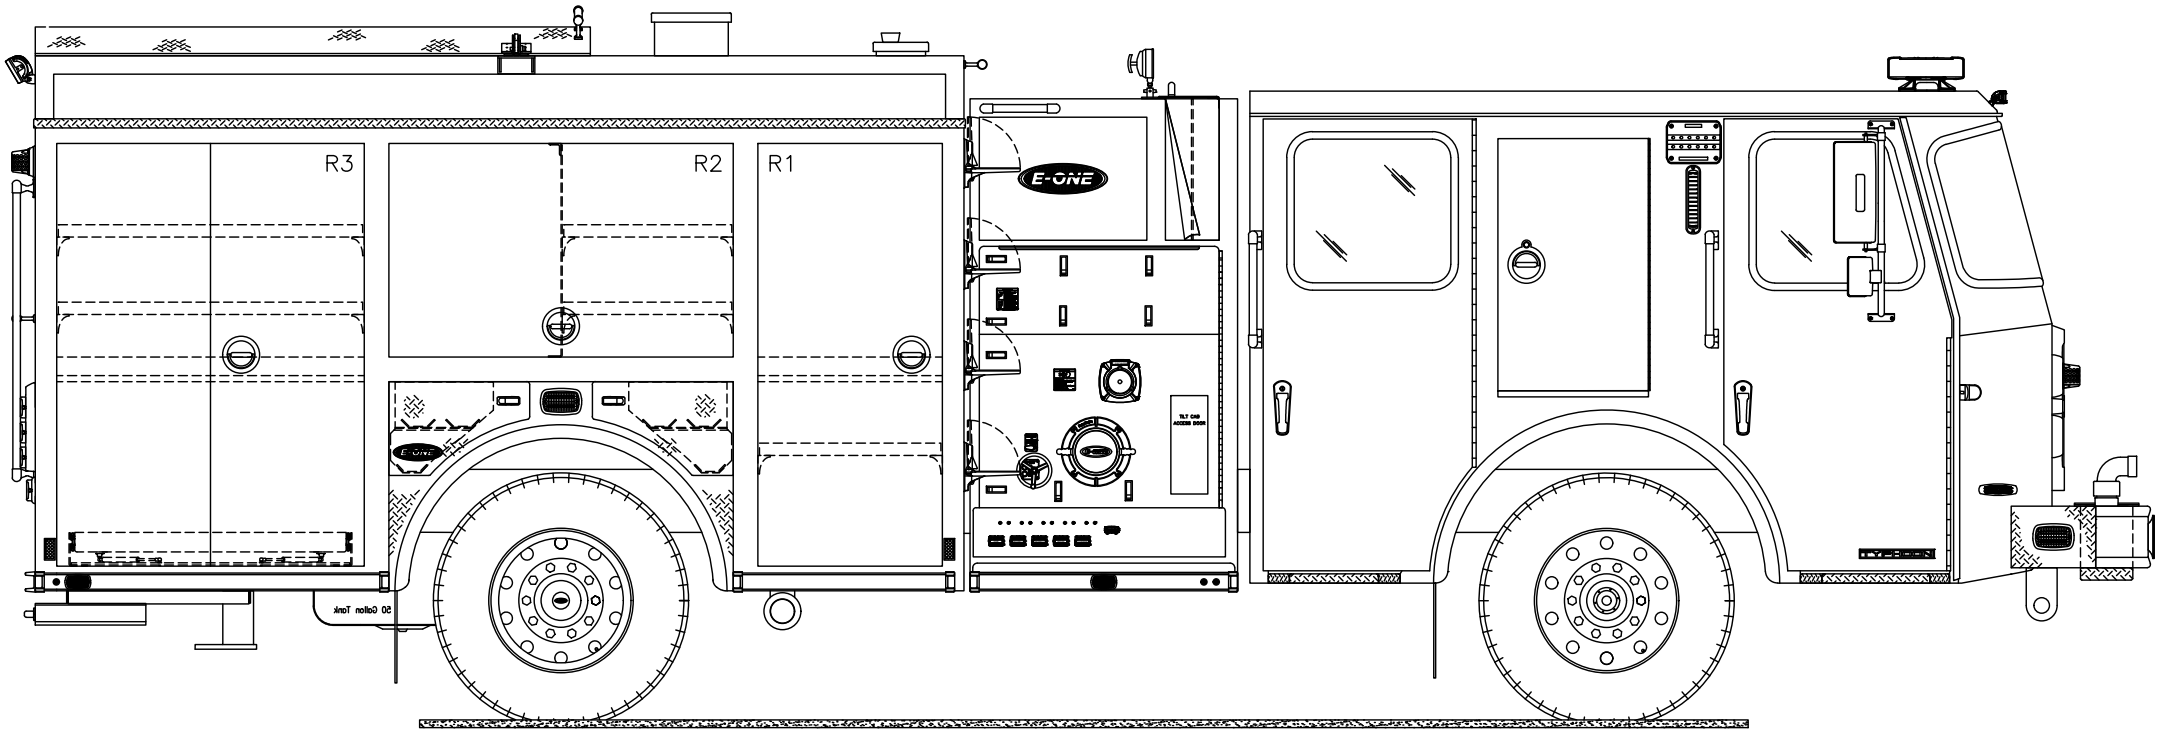

DRODMAN	A.6	ORDER RELEASE	2022-MAY-13	DRODMAN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
APPROVAL		REVISIONS	SHEET 2 OF 2	